

# EU DECLARATION OF CONFORMITY

## No. 5B-EU-32/23-12

In accordance with EU directive 2014/35/EU as amended

We, **KOPOS KOLÍN a. s.**  
 Havlíčkova 432  
 280 02 Kolín  
 Czech Republic  
 IČ: 61672971  
 DIČ: CZ61672971

declare under our sole responsibility that

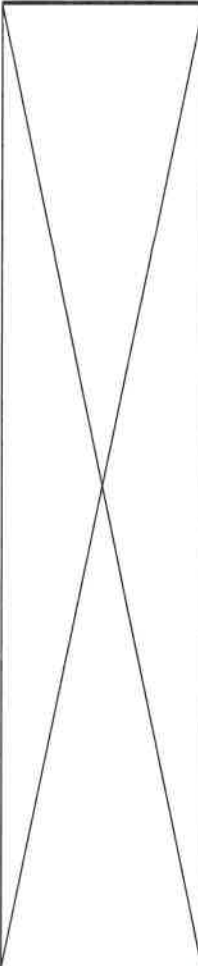
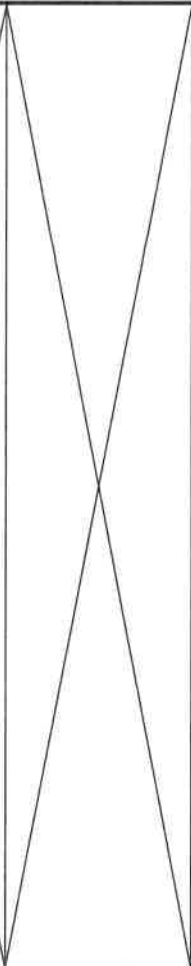
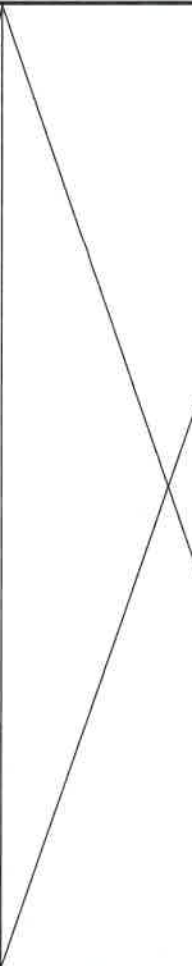


the product/type: **Fire protection wiring box**  
**KPZ 68...\_PO, KPZ 64...\_PO**

manufacturer: **KOPOS KOLÍN a.s., Havlíčkova 432, Kolín IV, 280 02 Kolín, Czech Republic**

object of the declaration: Box are designed for installation in non-load-bearing aerated plasterboard walls to prevent the spread of fire.  
 Minimum and maximum temperatures during installation are from -5 ° C to + 60 ° C.  
 The boxes are made of self-extinguishing material against excessive heat and burning, which is verified by means of the hot-loop test 850 °C according to the valid standard.  
 The enclosures fitted with the relevant lid meet the IP 30 protection.  
 The needle flame test was conducted in accordance with: ČSN EN 60695-11-5 with satisfactory result.

The object of the declaration described above is in conformity with the relevant Union harmonisation legislation, other legislation and regulations:

Regulations Of the European Union	Government Regulations	Standards	Certificates and Test Reports	Other technical specification
2014/35/EU - LVD	Law No. 90/2016 Coll. as amended  Government Regulation No. 118/2016 Coll. as amended	ČSN EN IEC 60670-1 ed.2:21+A11:21 including amendments (EN 60670-1:05 including amendments)  ČSN EN 60670-22:07 including amendments (EN 60670-22:06 including amendments)  ČSN EN 60695-11-5 ed. 2:17 including amendments (EN 60695-11-5 ed. 2:17 including amendments)	Test Report No. 231600-01/01 of 27.09.2023  <b>Issued by:</b> Electrotechnical Testing Institute, Pod Lisem 129, 171 02 Prague 71, Czech Republic	
		ČSN EN ISO 10140-2_2022	Report No. 040-073804 of 08.02.2023 on the test-Determination of Air sound insulation according to ČSN EN ISO 10140-2:2022  <b>Issued by:</b> Technical and Testing Institute of Construction PRAHA, s.p., Tolského 447, 415 03 Teplice, Czech Republic	Double sheathed plasterboard partitions with the 2x CW/UW 75 double metal construction filled with mineral wool ΔRw 69 dB.  <b>Tested products:</b> KPZ 68-45
			<b>Issued on the basis of protocol No. 040-073805 and 040-0738054 expert</b>	Expert opinion of the effect of electrical junction boxes on the weighted laboratory

				<p><b>opinion 040-074030 of 10.03.2023</b></p> <p><b>Issued by:</b>                  Technical and Testing Institute of Construction PRAHA, s.p., Tolského 447, 415 03 Teplice, Czech Republic</p>	<p>sound reduction index <math>R_w</math> of plasterboard walls.</p> <ol style="list-style-type: none"> <li>In all laboratory verified configurations we have found that the improvement/impairment of the weighted laboratory sound reduction index was <math>\Delta R_w = 0</math> dB.</li> <li> <ol style="list-style-type: none"> <li>The measured results are also valid for boxes with a smaller surface area.</li> <li>The measured results are also valid for boxes with smaller depths.</li> </ol> </li> <li>The results reported in 040-073805 and 040-073804 reports are valid for all double sheathed plasterboard partitions with a double metal construction filled with mineral wool with the weighted laboratory sound reduction index <math>R_w \leq 69</math> dB.</li> </ol>
				Regulation 1907/2006 - REACH	

By fulfilling the conditions in accordance with these regulations was placed on the product CE marking.  
 Conformity assessment module: **MODUL A: Internal production control**

Technical documentation of products:

- assembly instructions
- Datasheet
- Catalog for products freely available on <http://www.kopos.com/en/catalogy>
- Internal documents


KOPOS KOLÍN a.s. company is certificated according to the standard ISO 9001:2015, ISO 14001:2015 and ISO 50001:2018 and according to the National program „Safety Enterprise“.

Signed on behalf of KOPOS KOLÍN a.s.



Place of issue: Kolín, Czech Republic  
 Date of issue: 13.12.2023

Ing. Jana Dejmková  
 quality a ecology director


KOPOS KOLÍN a.s.   
 Havlíčkova 432, 280 02 Kolín  
 IČ: 616 72 971 DIČ: CZ61672971  
 tel: 321 730 111 [www.kopos.cz](http://www.kopos.cz)

**Enclosure No. 1 to EU Conformity Declaration No. 5B-EU-32/23-12****Fire protection wiring box**

KPZ 68-45 PO	Fire protection wiring box
KPZ 68-60 PO	Fire protection wiring box deep
KPZ 68-50/2 PO	Fire protection wiring box double
KPZ 68-50/3 PO	Fire protection wiring box triple
KPZ 68-50/4 PO	Fire protection wiring box quadruple
KPZ 68-50/5 PO	Fire protection wiring box fivefold
KPZ 64-45 PO	Fire protection wiring box
KPZ 64-60 PO	Fire protection wiring box deep
KPZ 64-50/2 PO	Fire protection wiring box double
KPZ 64-50/3 PO	Fire protection wiring box triple
KPZ 64-50/4 PO	Fire protection wiring box quadruple
KPZ 64-50/5 PO	Fire protection wiring box fivefold

**Accessories**

V 68HF	Cover
--------	-------

**KOPOS KOLÍN a.s.**   
Havlíčková 432, 280 02 Kolín  
IČ: 616 72 971 DIČ: CZ61672971  
tel: 321 730 111 [www.kopos.cz](http://www.kopos.cz)

